




# SES TELEPHONE ENTRY, MODEL SG-2 WITH ELITE SL 3000 OPERATOR

NETWORK INTERFACE  
[SUPPLIED BY PHONE CO.  
USUALLY ON HOUSE NEAR  
THE ELECTRIC METER]


INSIDE THE  
NETWORK INTERFACE

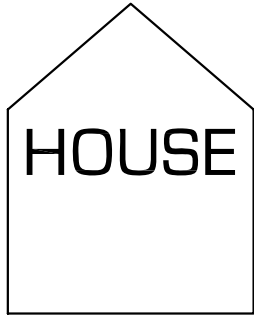

16 VOLT TRANSFORMER  
(CAN BE PLUGGED IN AT  
HOUSE OR IN A WEATHER-  
PROOF CABINET NEAR  
GATE SITE.

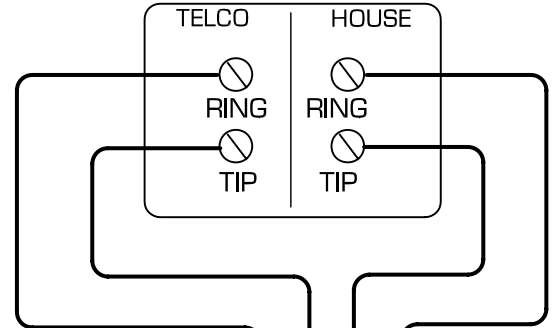

ELITE SL 3000 TERMINALS

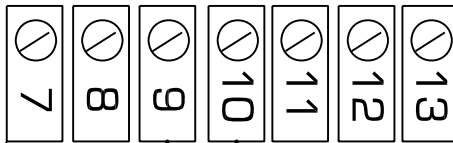


USE SHIELDED  
DIRECT BURIAL  
TWO CONDUCTOR  
16 GA.  
BETWEEN TRANS-  
FORMER AND  
THE TEL-ENTRY

USE SHIELDED  
DIRECT BURIAL  
"TWO PAIR"  
PHONE LINE  
BETWEEN  
NETWORK  
INTERFACE &  
THE SG-2

CABLE A

CABLE C

SL-3000  
OPERATOR

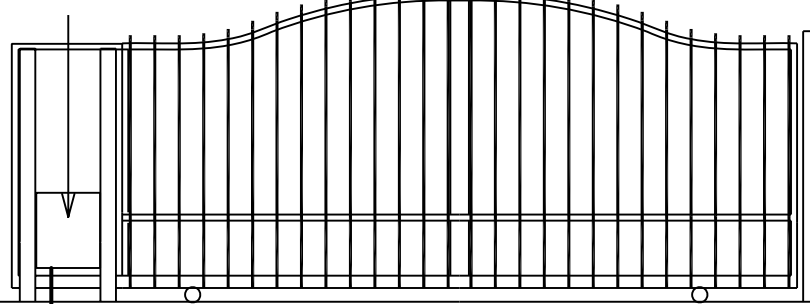


CABLE A

CABLE B

CABLE C

SG 2 TEL-  
ENTRY




USE SHIELDED DIRECT  
BURIAL TWO CONDUCTOR 16  
GA. BETWEEN THE GTO CABINET  
AND THE TEL-ENTRY

TO 16 VOLT  
TRANSFORMER

CABLE B

COPPER PLATED  
GROUND STAKE-  
MUST BE USED

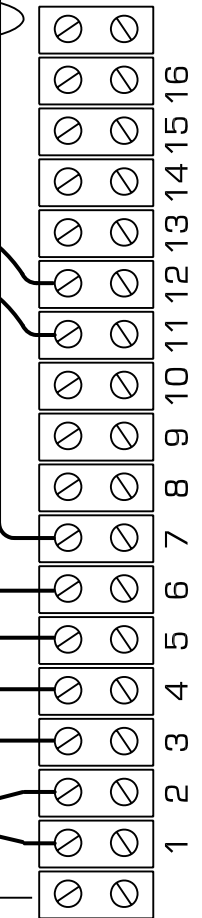

TERMINAL  
STRIP IN  
SG-2 UNIT

NOTE: THIS IS A BASIC SCHEMATIC FOR  
AN SG-2 AND AN ELITE SL 3000. PLEASE  
SEE THE SES MANUFACTURER'S  
INSTRUCTIONS FOR OTHER OPTIONS AND  
THE PROGRAMMING INSTRUCTIONS FOR  
THE TELEPHONE SYSTEM.