




SES TELEPHONE ENTRY, MODEL SG-2 WITH ELITE SL 3000 OPERATOR

NETWORK INTERFACE
[SUPPLIED BY PHONE CO.
USUALLY ON HOUSE NEAR
THE ELECTRIC METER]


INSIDE THE
NETWORK INTERFACE

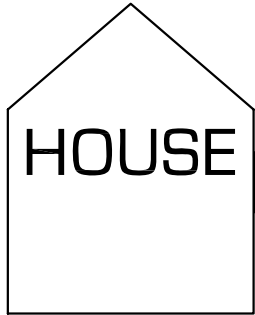

16 VOLT TRANSFORMER
(CAN BE PLUGGED IN AT
HOUSE OR IN A WEATHER-
PROOF CABINET NEAR
GATE SITE.

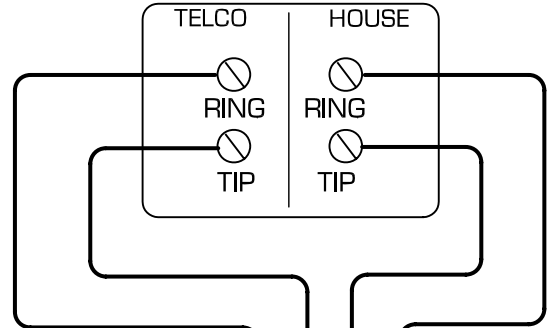


ELITE SL 3000 TERMINALS

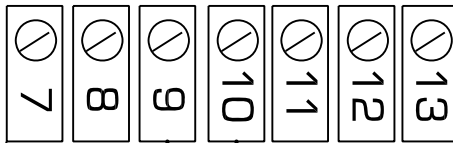

USE SHIELDED
DIRECT BURIAL
TWO CONDUCTOR
16 GA.
BETWEEN TRANS-
FORMER AND
THE TEL-ENTRY

USE SHIELDED
DIRECT BURIAL
"TWO PAIR"
PHONE LINE
BETWEEN
NETWORK
INTERFACE &
THE SG-2

SL-3000
OPERATOR

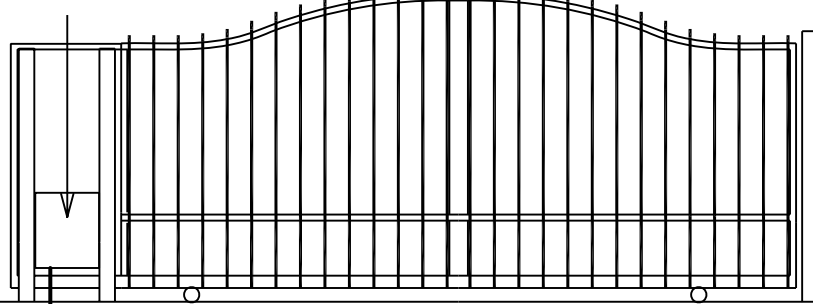


CABLE A

CABLE C

16
15
14
13
12
11
10
9
8
7
6
5
4
3
2
1

TERMINAL
STRIP IN
SG-2 UNIT

SG 2 TEL-
ENTRY



USE SHIELDED DIRECT
BURIAL TWO CONDUCTOR 16
GA. BETWEEN THE GTO CABINET
AND THE TEL-ENTRY

TO 16 VOLT
TRANSFORMER

COPPER PLATED
GROUND STAKE-
MUST BE USED

NOTE: THIS IS A BASIC SCHEMATIC FOR AN SG-2 AND AN ELITE SL 3000. PLEASE SEE THE SES MANUFACTURER'S INSTRUCTIONS FOR OTHER OPTIONS AND THE PROGRAMMING INSTRUCTIONS FOR THE TELEPHONE SYSTEM.